925 hPa Temp Analysis
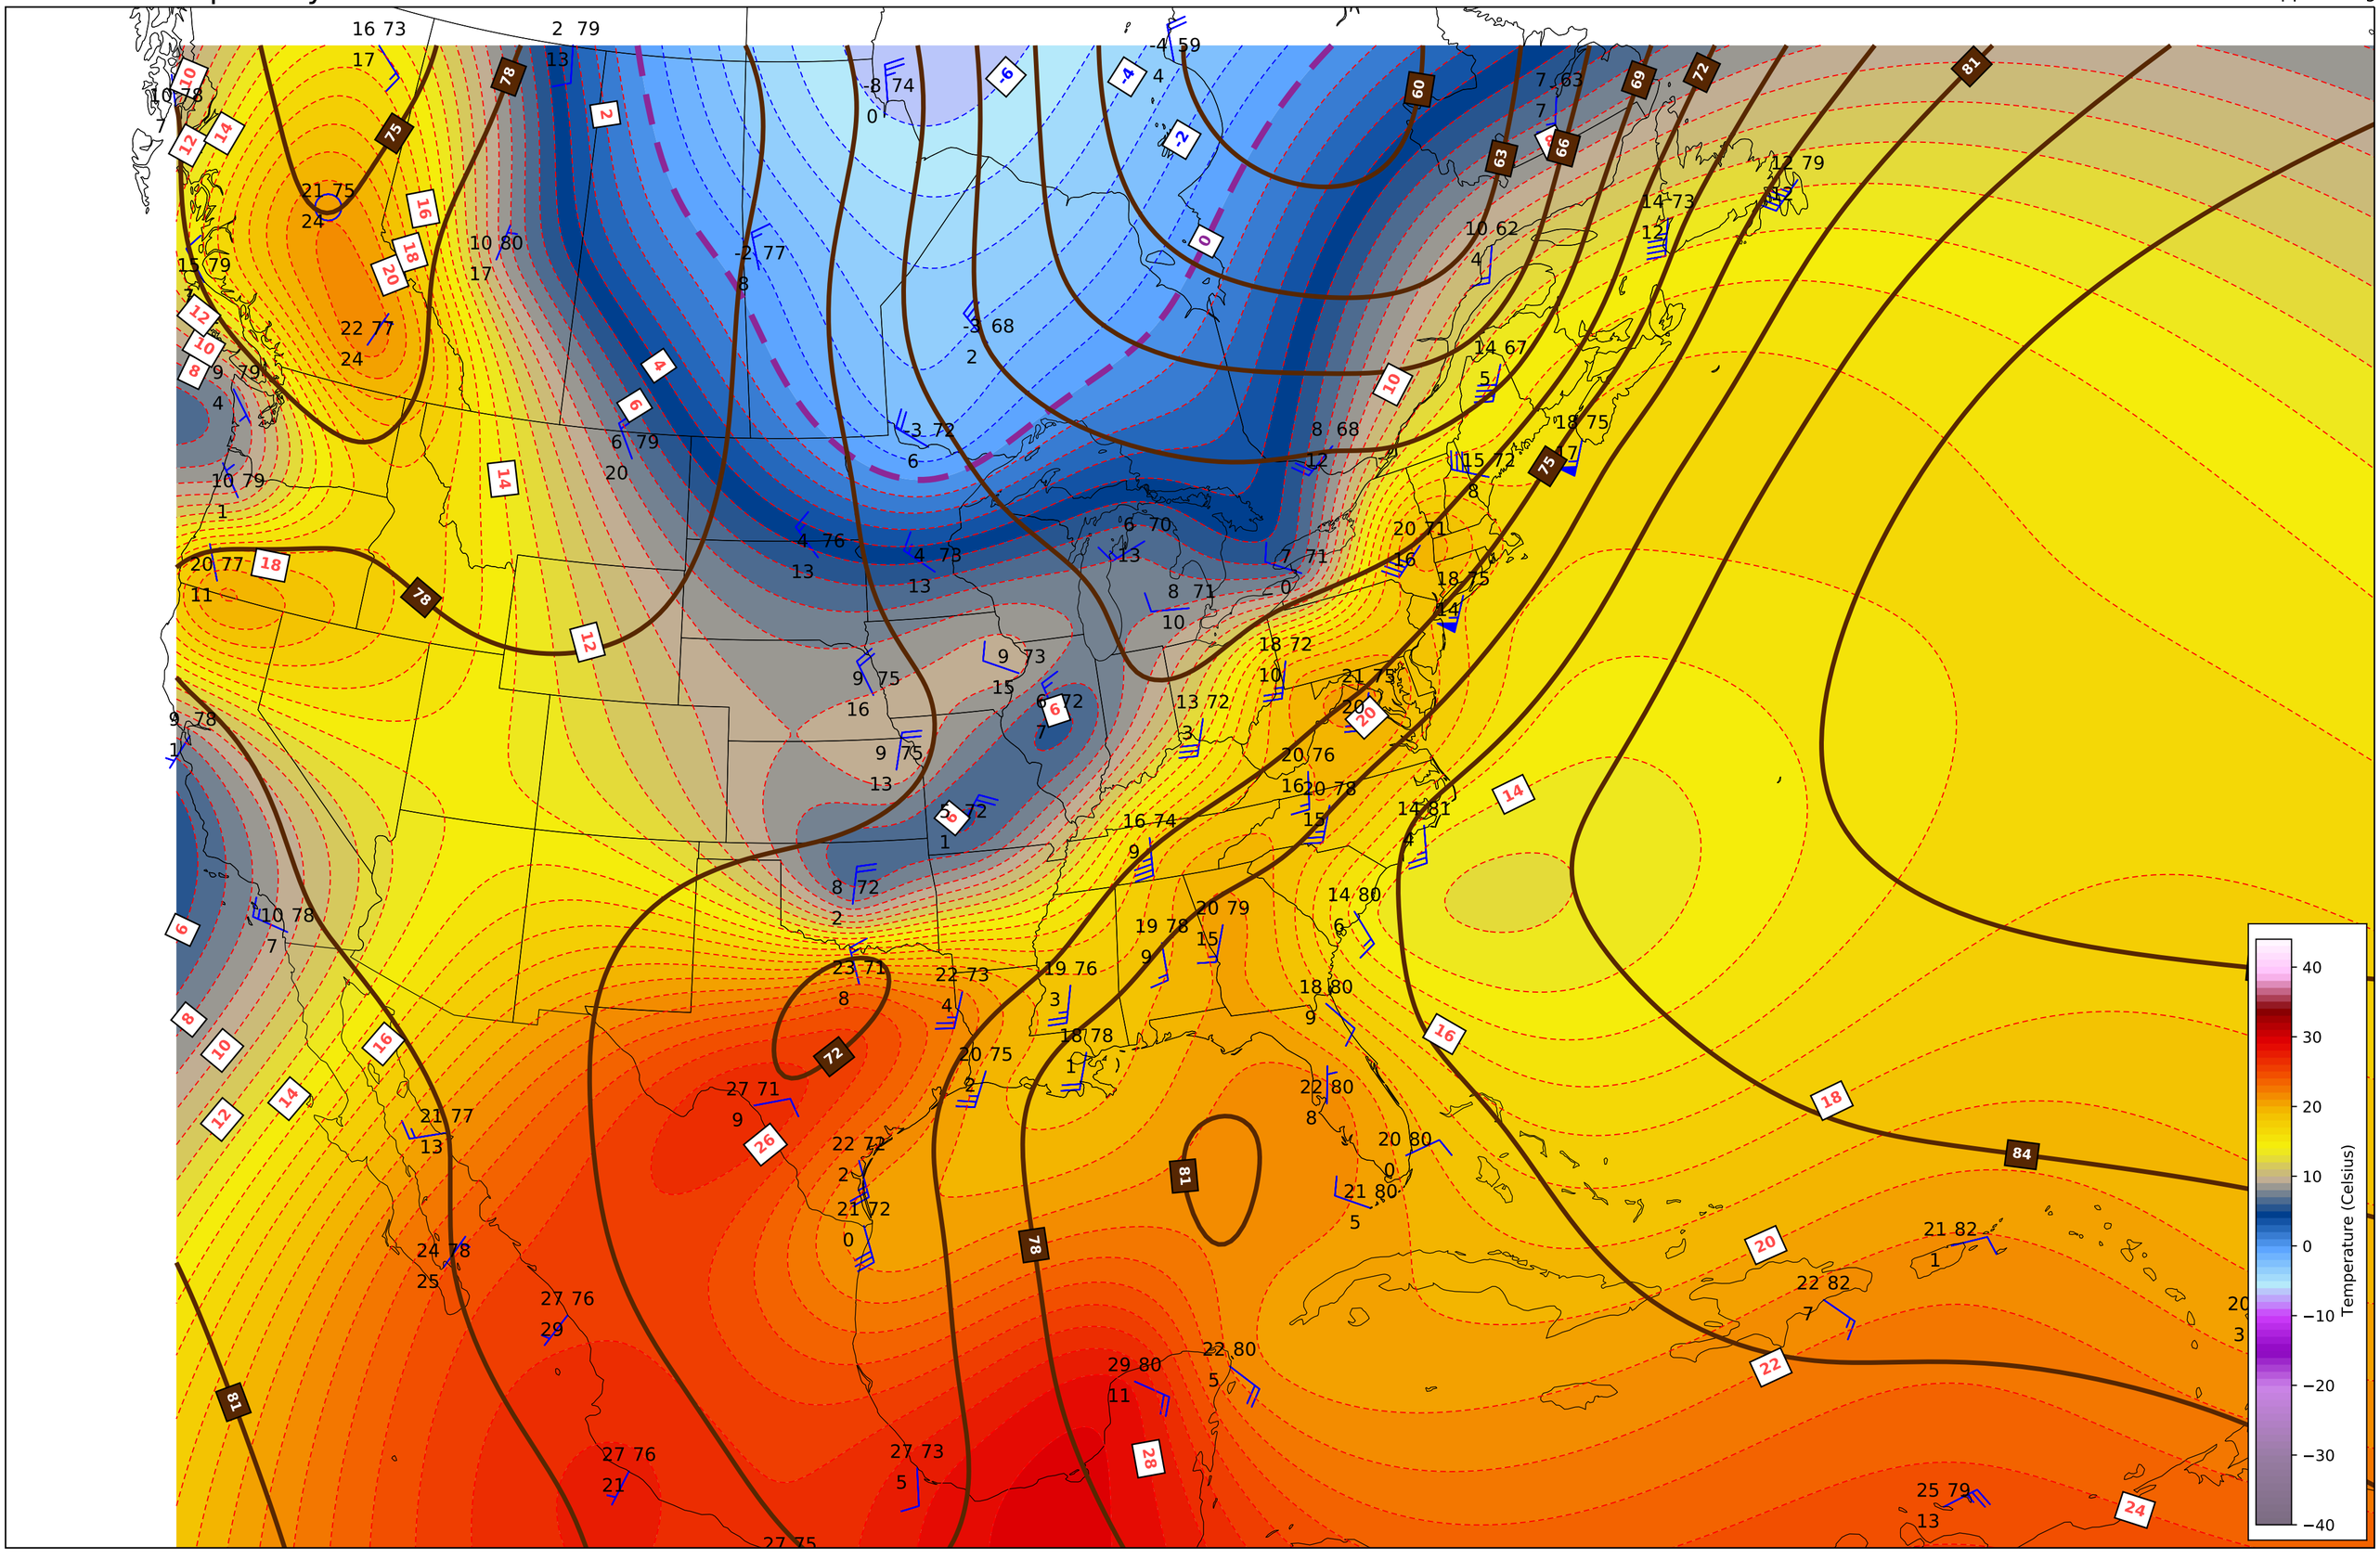
Valid: 0Z 5-6-2026
www.doppler5.org